


AUTOMATED ENTRANCE
PHONE: (517) 279-7533 FAX: (517) 279-0125

DIAGRAM 2 KNOWING ACT OPERATION
KNOWING-ACT OPERATION

NOTE: Secondary Activation Sensors shown at right are active only when the door is not closed. "L.OUT" Delay potentiometer must be adjusted so that "LOCK OUT" orange LED remains on until door is closed. (See Adjustment Instructions)

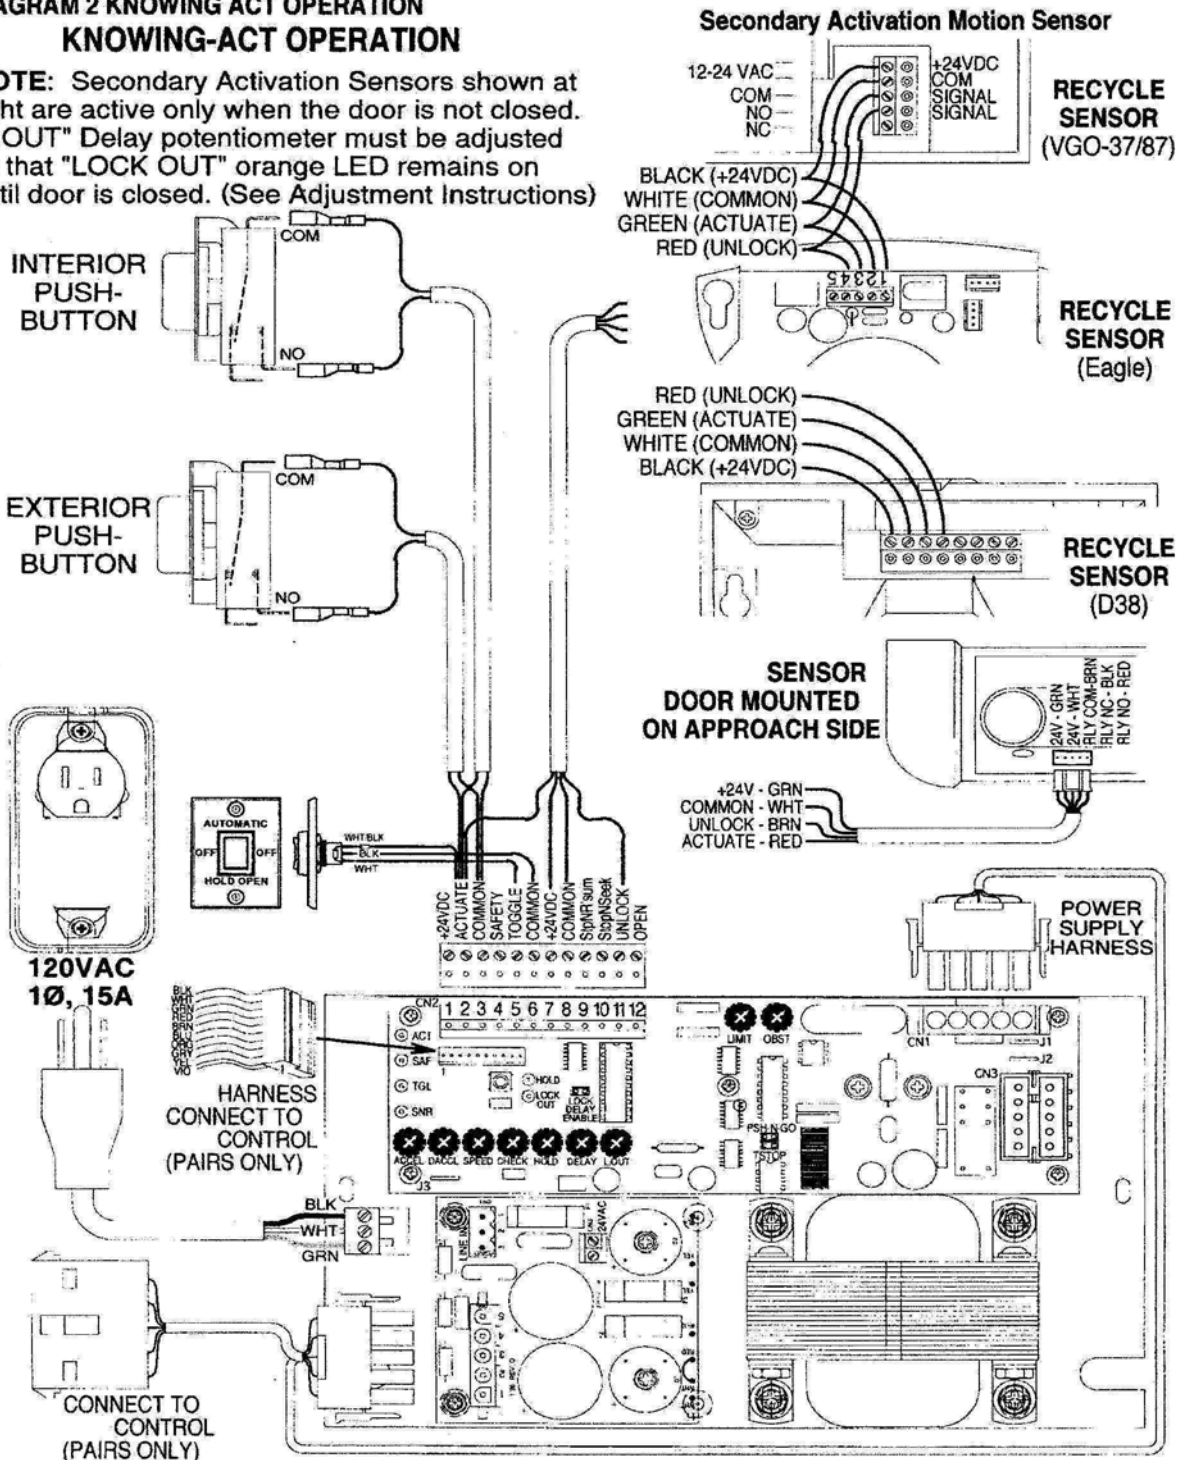

Knowing-Act Swing Operator Wiring